


All doors marked  $\Delta$  to be half hour fire doors, self closing with combined intumescent strip and cold smoke seal.  
 VP indicates vision panel glazed 6 thick q-w.p.p.

Half hour fire resistant screen - see typical detail

> Fire alarm call point.

D Wall mounted fire bell.

Increase height of balustrade to min 900, see typical detail.

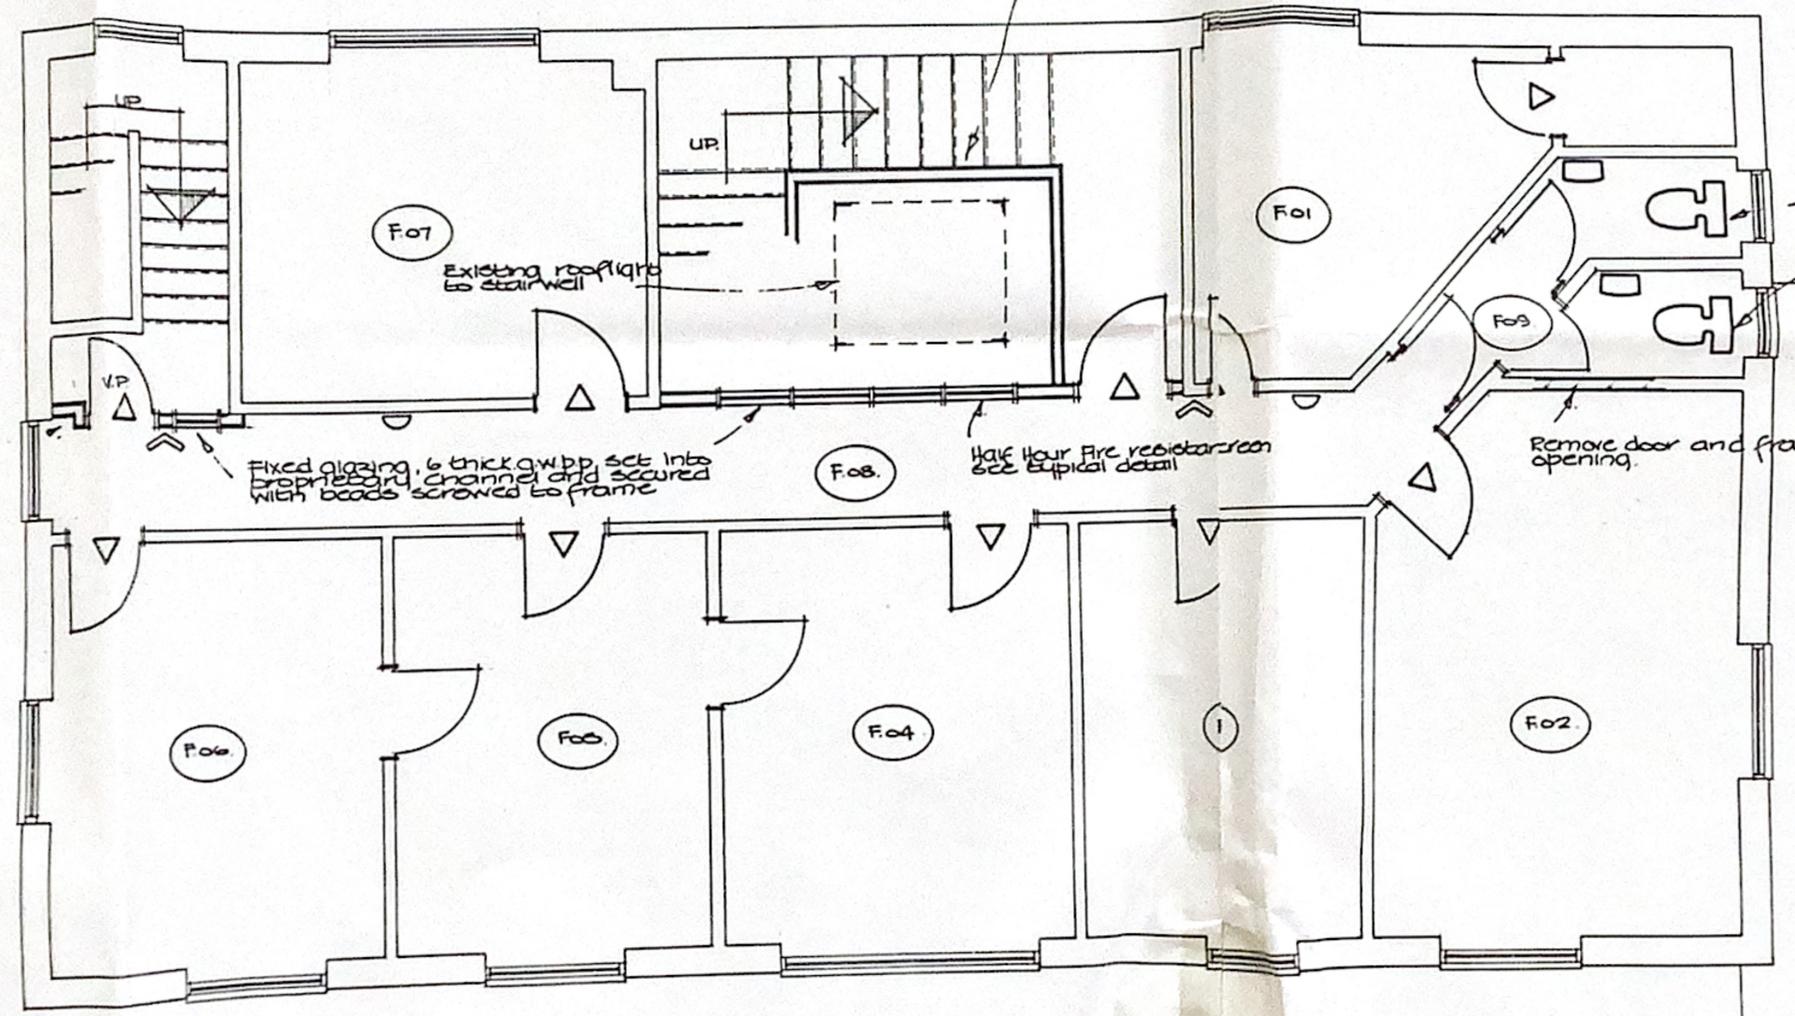

Provide and fit new door and frames to amended W.C. cubicles.

Remove door and frame and infill opening.

Fixed glazing, 6 thick q.w.p.p. set into proprietary channel and secured with beads screwed to frame

Half hour fire resistant screen see typical detail

Existing roof lights to stairwell

FIRST FLOOR PLAN